


Momentary Dry Contact Output (D.C.O.) Card

D.C.O. Card Top View

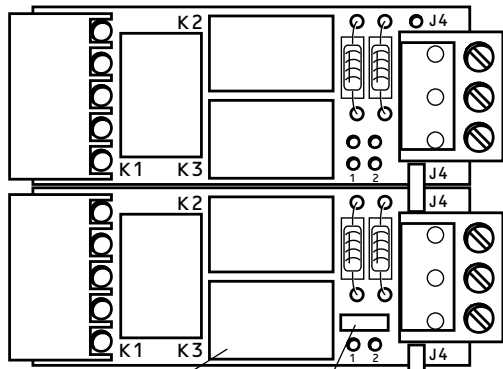


2A 30VDC Dry Contact Output Relays

Black Jumper


Jumper J4 connects commons between D.C.O.s

D.C.O. Jumper Settings

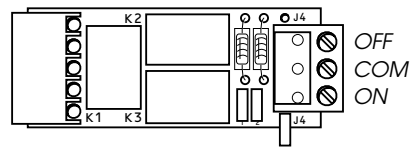

BAS/IFM Operation



- Jumpers in position 1 and 2
- Momentary output 3-wire
- Diodes D1 and D2 shorted

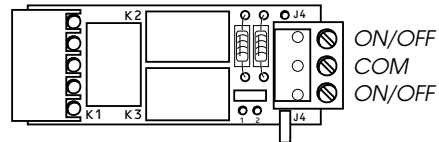

Direct TR120, TR277 or 2PC Relay Operation

- Jumper 3 used only
- Momentary output 2-wire
- Diodes D1 and D2 operational (+ ON/- OFF)
- For TR relays remove common jumper (J4)

Typical Installation

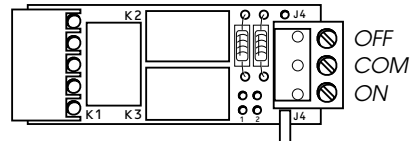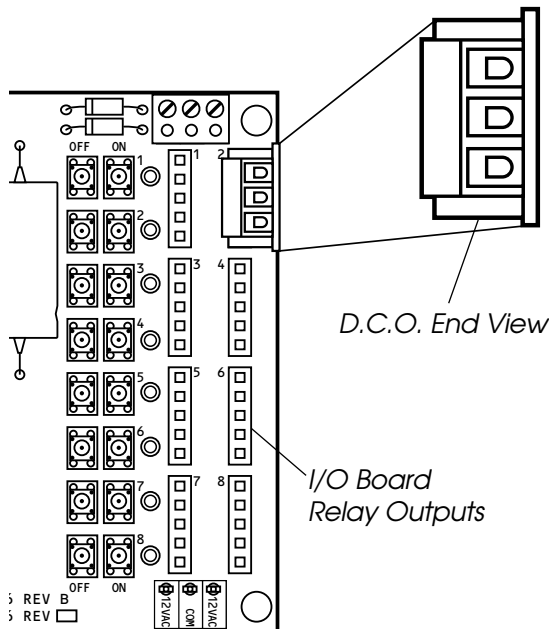

- No jumpers used
- Momentary output 3-wire
- Diodes D1 and D2 operational (+ ON/- OFF)

NOTE: Output duration can be set to 17ms or 50ms. TR and 2PC relays require a 50ms pulse width for proper operation. Consult factory for details.